







PRODUCT DESCRIPTION

The H150-TQG has been thoughtfully engineered for simple installation in apartments, condos, and small houses. The removable collars are top-mounted, which makes the unit both narrow and shallow enough to fit inside standard closets and other tight spaces.

Recommendation : Ideal for homes from 1500ft² to 2500ft²

KEY FEATURES

Electronically and independently adjustable supply and exhaust blowers (FLEXControl)

Gauge ports on the door for fast and reliable airflow readings

Exclusive EvacMax[™] feature that pondes on-demand boost for maximum ventilation

Non-dust-loading backward-inclined impellers on totally enclosed motors

Twist-in collars for easy flex-duct attachment

Easy access to core and filters for cleaning

Extremely durable polypropylene core

Recirculation defrost to maintain a neutral pressure in the home, and using only the four duct connections. No fifth duct connection required

RESIDENTIAL

HRV

H150-TQG

HEAT RECOVERY VENTILATOR 133 CFM at 0.20 in.w.g (ESP)





Recovery Core Material: Polypropylene

Casing

Material: Pre-painted 24-gauge galvanized steel Drain Connection: Ø 3/8" (Ø 10 mm) Duct Connections: Ø 5" (Ø 127 mm) Insulation: Molded EPS Width: 23-1/8" (587 mm) Height: 16-3/4" (425 mm) Height: 12-3/8" (314 mm) Weight: 32 lbs (15 kg); Shipping Weight: 40 lbs (18 kg) Supply Damper: Motorized



Mounting

Suspended by chains with vibration-isolating springs Wall-mounting accessory available (P/N 608575)



Electrical requirement

120 VAC, 60Hz, 1.3A, 156W Cord Set: 48" (1219 mm) with ground



Frost control

Automatic timed recirculation, four port Cycles controlled by a temperature sensor when the outdoor temperature drops below 23°F (-5°C)



Filters


Type : Two MERV6 filters (P/N 612409) Option : Two MERV13 filters (P/N 612410)



Blowers

Motorized impellers (backward-inclined)


Dimensions

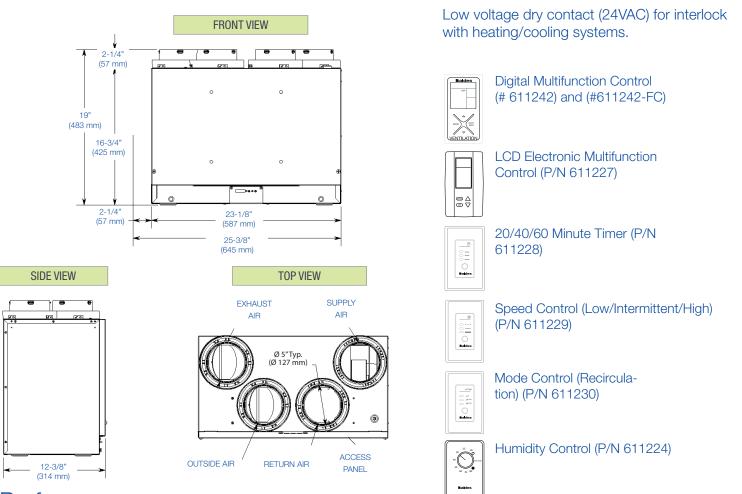

Controls

Performance

Supply Temperature		Net Airflow		Power	Sensible Recovery	Adjusted Sensible
°F	°C	CFM	L/s	Consumed (W)	Efficiency	Recovery Efficiency
32	0	53	25	44	67%	73%
32	0	66	31	48	65%	70%
32	0	100	47	88	59%	65%
-13	-25	66	31	72	60%	63%

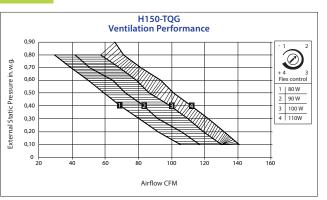

Project:	Architect:	
Location:	Engineer:	
Model #:	Contractor:	
Quantity:	Comments:	
Submitted By:		
Date:		

2017 ALDES Canada. Reproduction or distribution, in whole or in part, of this document, in any form or by any means, without the express written consent of ALDES Canada, is strictly prohibited. The information contained within this document is subject to change without prior written notice.